Dischargers

Municipal

&

Industrial

Salt Lake City
Water Reclamation Plant

N
W Center S
Image State of Utah
© 2008 Tele Atlas
©2007 Goog
°50'34.32" N 111°56'45.81" W elev 4215 ft
Streaming 100%
Eye alt

W 1200 N
Image State of Utah
© 2008 Tele Atlas
©2007 Goo

N 1700
Waterylln
W 600
Image State of Utah
© 2008 Tele Atlas

N
Image State of Utah
© 2008 Tele Atlas
©2007 Google™

Treatment Plant Flows

Facility	Flow (MGD)
South Valley Sewer District	15 MGD
South Valley Water Reclamation Facility	50 MGD
Central Valley Water Reclamation Facility	75 MGD
Salt Lake City Water Reclamation Plant	56 MGD
South Davis Sewer District Plants	16 MGD
Central Davis Sewer District	10 MGD
North Davis Sewer District	34 MGD
Central Weber Sewer District	45 MGD
Brigham City	4 MGD
Tremonton City	2 MGD

Discharge Quantity

- 220,000,000 gallons per day to the GSL

Or

- 246,000 Acre Feet Annually

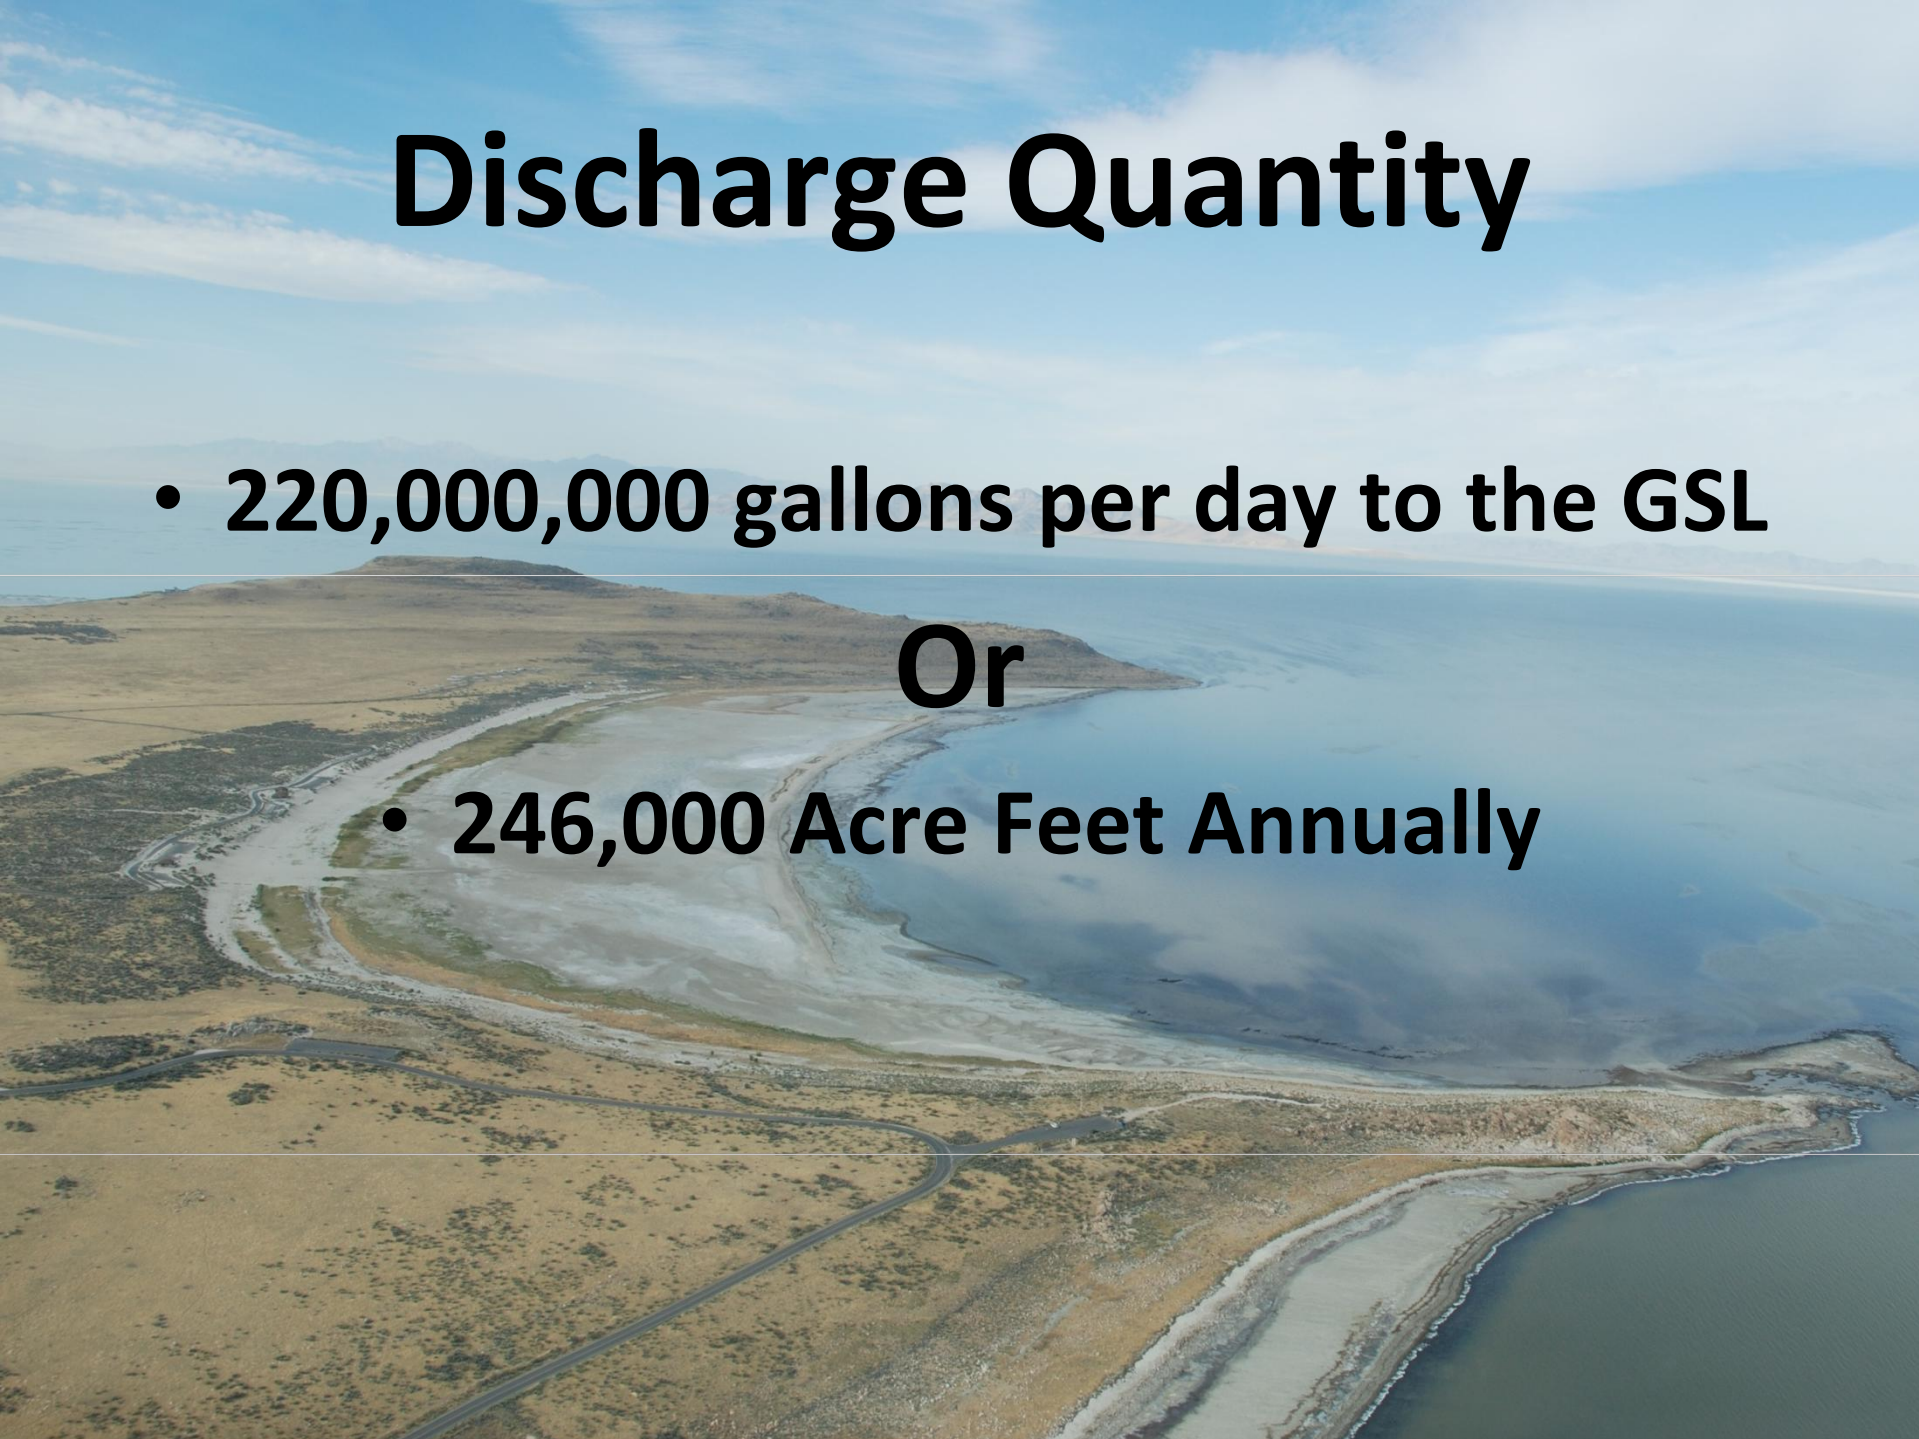

Mission Critical: Clean Water

We can make it as clean as technology can get it!

It is just MONEY

Wastewater Treatment Balancing Act

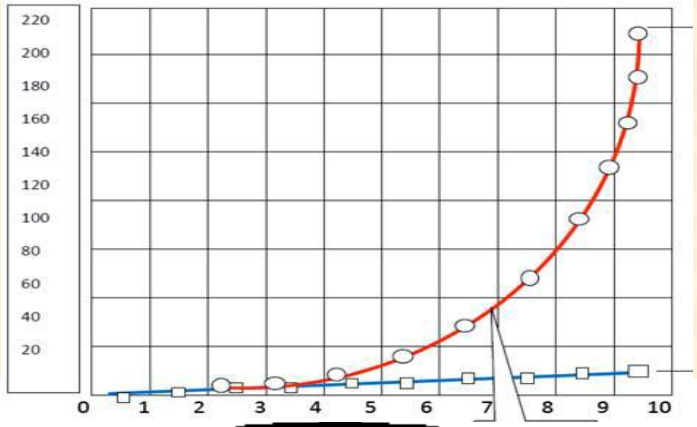

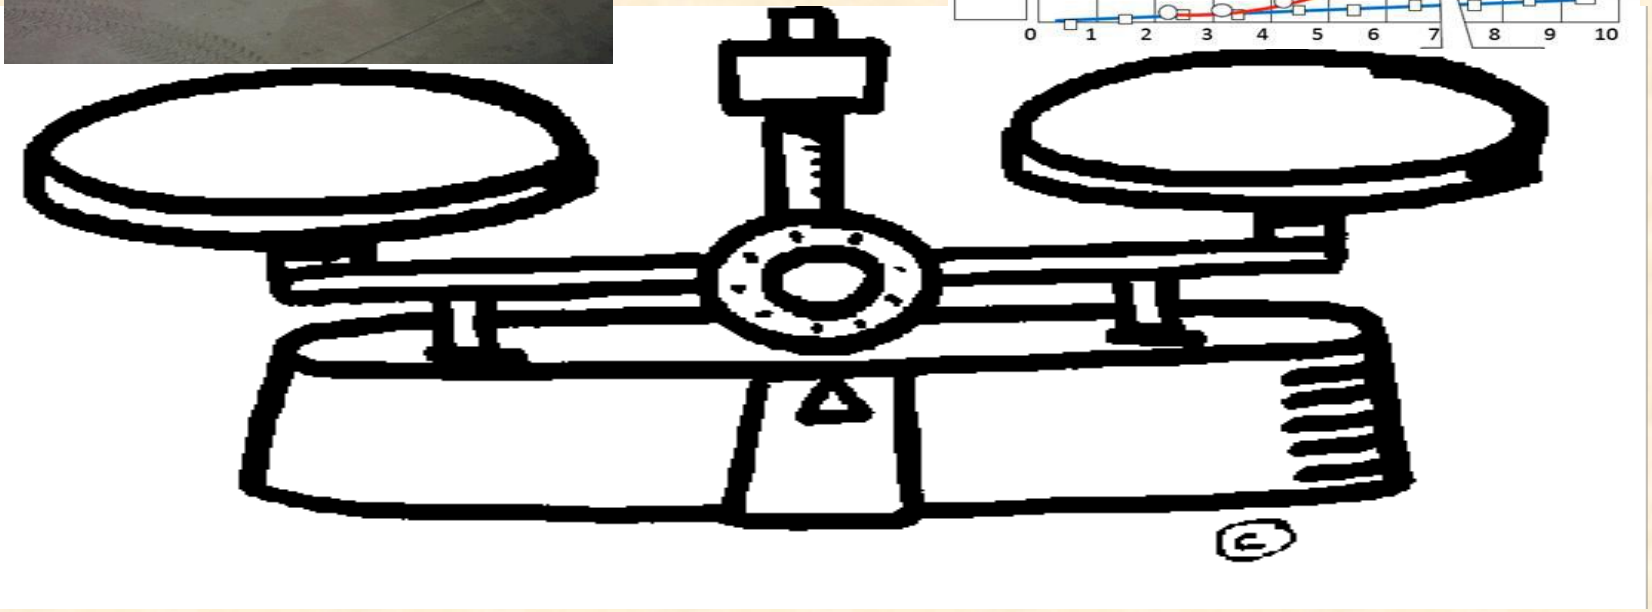

Citizens pay

Some Additional Nutrient Removal	$600,000,000
Significant Additional Nutrient Removal	$1,800,000,000
Nutrients and Some Pharmaceuticals	$2,400,000,000
Limits of Technology Nutrients and Pharmaceuticals	$5,000,000,000 (?)

Industrial Wastewater